


Aljen Heights

Ledyard

ALJEN HEIGHTS PHASE 2

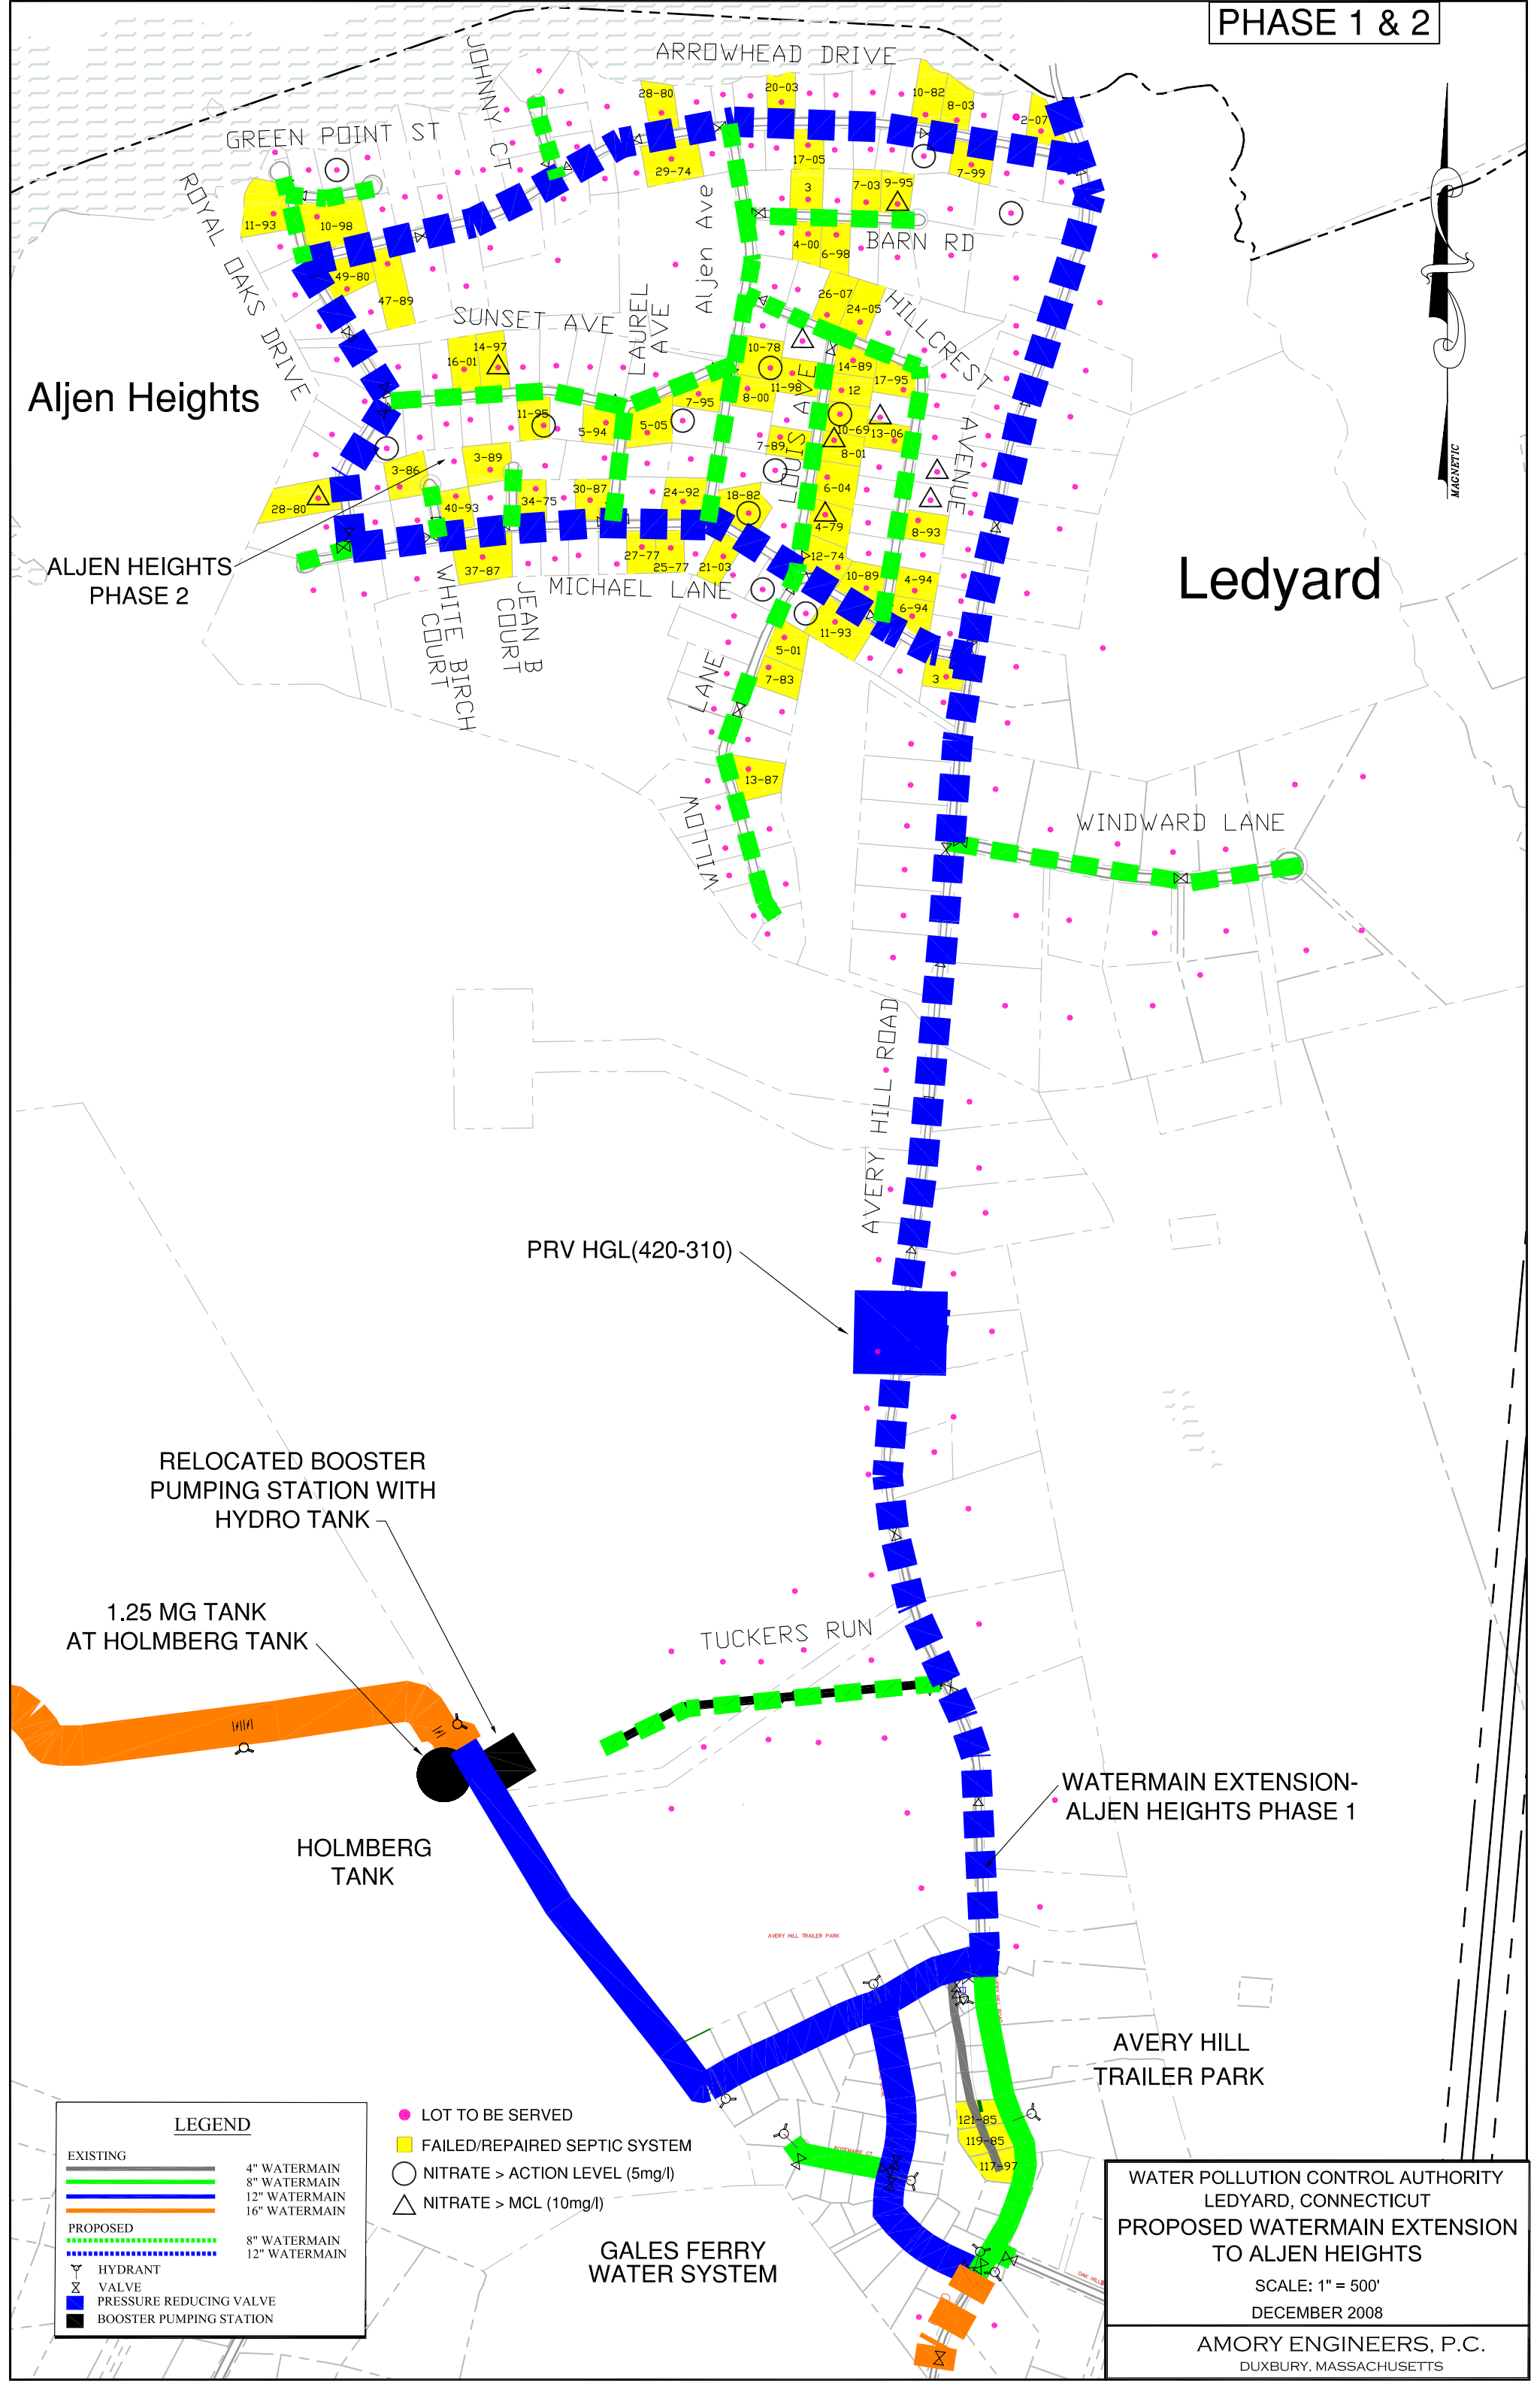

RELOCATED BOOSTER PUMPING STATION WITH HYDRO TANK

1.25 MG TANK AT HOLMBERG TANK

HOLMBERG TANK

PRV HGL(420-310)

TUCKERS RUN

WATERMAIN EXTENSION-ALJEN HEIGHTS PHASE 1

AVERY HILL TRAILER PARK

GALES FERRY WATER SYSTEM

LEGEND

EXISTING		● LOT TO BE SERVED
	4" WATERMAIN	■ FAILED/REPAIRED SEPTIC SYSTEM
	8" WATERMAIN	○ NITRATE > ACTION LEVEL (5mg/l)
	12" WATERMAIN	△ NITRATE > MCL (10mg/l)
	16" WATERMAIN	
PROPOSED		
	8" WATERMAIN	
	12" WATERMAIN	
	HYDRANT	
	VALVE	
	PRESSURE REDUCING VALVE	
	BOOSTER PUMPING STATION	

WATER POLLUTION CONTROL AUTHORITY
LEDYARD, CONNECTICUT
PROPOSED WATERMAIN EXTENSION TO ALJEN HEIGHTS
SCALE: 1" = 500'
DECEMBER 2008
AMORY ENGINEERS, P.C.
DUXBURY, MASSACHUSETTS